



IESNA LM79-2008 Test Report

TÜV SÜD America

Photometric Testing and Evaluation in Accordance with LM79-2008

Report Prepared for:

David Delgado
Applications Engineer

Maxlite Inc.
12 York Ave.
West Caldwell, NJ 07006
United States

Telephone: (800) 555-5629

Sample Tested: ELLF180UM50
Sample Description: Architectural Flood and Spot Luminaires
Manufacturer: Maxlite, Inc.

Technical Report Number: J11404143-01-LM79
Report Issue Date: April 25th, 2014
Total Number of Pages: 10 (including this page)

Report Prepared by:

Byrd Evans
TÜV SÜD Project Handler

Report Reviewed by:

Bryan Cubitt
TÜV SÜD Program Manager



IESNA LM79-2008 TEST REPORT

April 25, 2014

Summary of Key Test Results

Model# **ELLF180UM50**

Manufacturer **Maxlite, Inc.**

TÜV Sample# 1307-1

Date of Test April 18th 2014

Notes: Tested in intended orientation
(Horizontal)



Parameter	Measured Result
Luminous Flux	18,000 Lumens
Input Power	177.51 Watts
Efficacy	101.4 Lumens/Watt
C.C.T.	5747 K
C.R.I. (R _a)	75.8
Beam Angle	58.1°
Stabilization Time	60 minutes
In-Situ Temp Test (ISTMT) **	82.6°C (LED)

The above results are recorded / derived from measurements in accordance with LM79-08.

**ISTMT in accordance with “Energy Star Program Requirements for Luminaires – Version 1.2”.



IESNA LM79-2008 TEST REPORT

April 25, 2014

TABLE OF CONTENTS

Test Results4

Spectral Flux and Chromaticity Diagram5

Zonal Lumen Summary5

Illuminance Plots.....6

Candela Plots6

ISTMT Temperature Measurement7

Addendum A DLC Program Results.....8

Photometric Testing Information9

Equipment List:10





IESNA LM79-2008 TEST REPORT

April 25, 2014

Test Results –

The following results were obtained after stabilization of the sample in accordance with the requirements set forth in section 5.0 of IES LM79-2008. Stability is achieved when the variation of 3 readings of light output and electrical power over a period of 30 minutes, taken 15 minutes apart, is less than 0.5%.

Photometric Results	Maxlite- ELLF180UM50	
	Integrating Sphere	
Total Luminous Flux (Lumens)	18,000	
Luminous Efficacy (Lumens/Watt)	101.40	
Total Radiant Flux (Watts)	56.1	
Correlated Color Temperature (CCT)	5747	
Color Rendering Index (CRI – R _a)	75.8	
R ₉ Value	-24.3	
Chromaticity (Chroma x / Chroma y)	0.3268 / 0.3437	
Chromaticity (Chroma u / Chroma v)	0.2020 / 0.3187	
Chromaticity (Chroma u' / Chroma v')	0.2020 / 0.4780	
D _{uv} Value	0.00390	

Electrical Results (120V unless stated otherwise)	Maxlite- ELLF180UM50	
	Integrating Sphere	
Input Power (Watts)	177.51	
Input Voltage (Volts AC)	120.01	
Input Current (Amps)	1.485	
Power Factor @120VAC	0.996	
Power Factor @277VAC	0.936	
Input Frequency (Hertz)	60.0	
A-THD @120VAC (Current %)	5.57 %	
A-THD @277VAC (Current %)	10.75 %	

Additional Parameters	Maxlite- ELLF180UM50	
	Integrating Sphere	Goniophotometer
Stabilization Time (Light and Power)	60 minutes	51 minutes
Test Geometry Configuration	4π	Type C
Ambient Temperature	25.4°C	25.2°C
ISTMT (In-Situ Temperature Measurement)	82.6°C (LED)	
Spacing Criteria	0.90 (0° – 180°) / 0.88 (90° – 270°)	




IESNA LM79-2008 TEST REPORT

Report# J11404143-01-LM79

April 25, 2014

Spectral Flux and Chromaticity Diagram


Spectral Flux

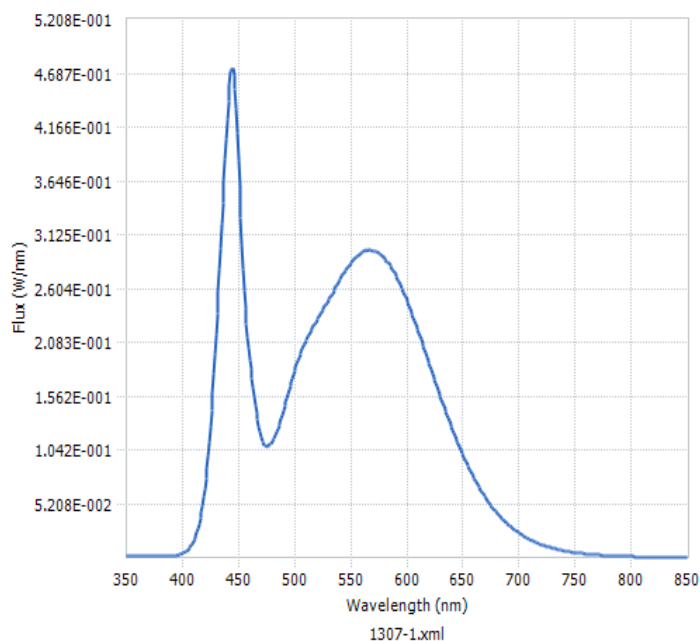

Spectral response of the Radiant Flux

(350nm to 850nm)

Chromaticity Diagram

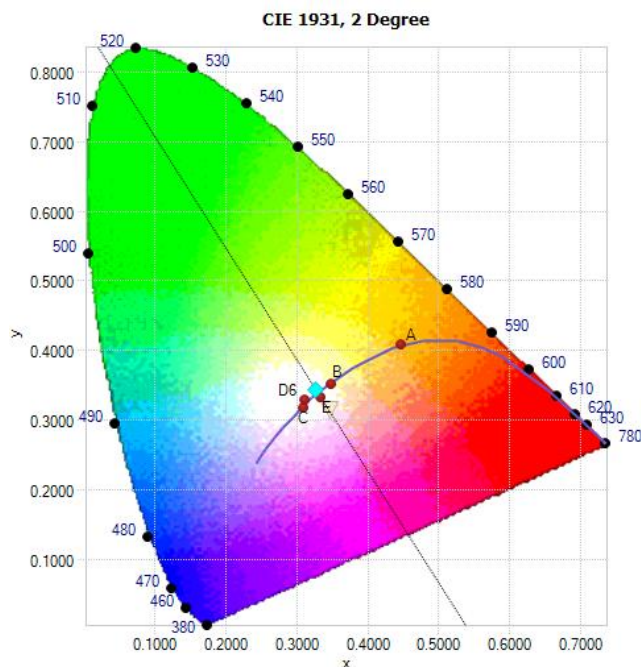

Tristimulus values (from page 4):

$x / y = 0.3268 / 0.3437$

The locations on the diagram of the tristimulus coordinates are indicated by the blue diamond.

Zonal Lumen Summary

Zone	Lumens	% Lamp / Luminaire
0 - 60	17,948.6	98.6 %
60 - 90	263.3	1.4 %
0 - 90	18,211.9	100 %
90 - 180	0.0	0.0 %
0 - 180	18,211.9	100 %

TUV SUD America, Inc.
5945 Cabot Parkway, Suite 100,
Alpharetta GA 30005

Telephone: 678-341-5900 www.tuvamerica.com

Page 5

NRG_F_10.04

Confidential Report



Lab Code: 500065-0

TUV SUD America is
accredited under the
NVLAP EEL program.






IESNA LM79-2008 TEST REPORT


April 25, 2014

Test Results – Illuminance Plots

The following images depict the illuminance characteristics of the luminaire.

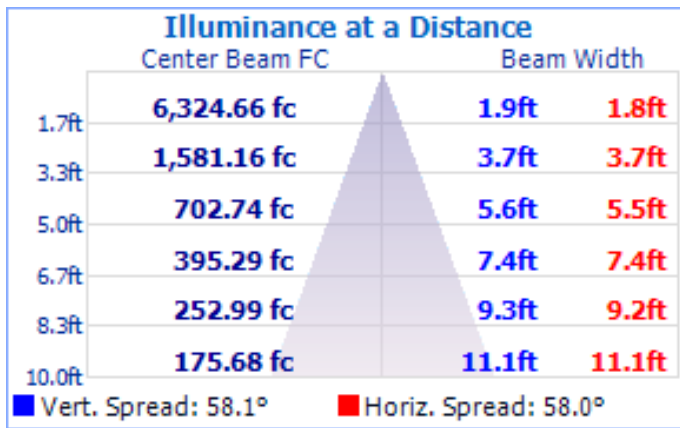


Beam Angle = 58.1°

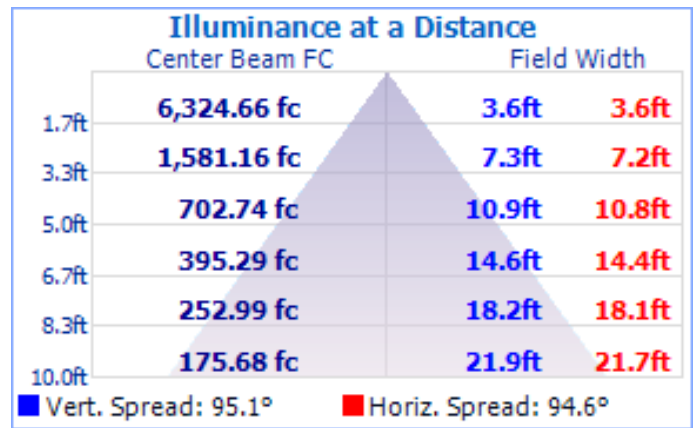


Field Angle = 95.1°

Test Results – Candela Plots


The following images depict the luminous intensity distribution characteristics of the luminaire:

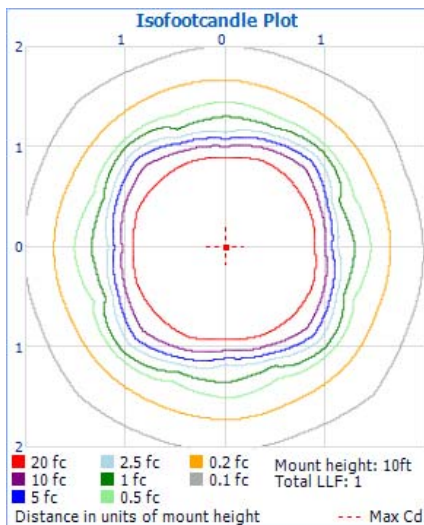

Isofootcandle Plot

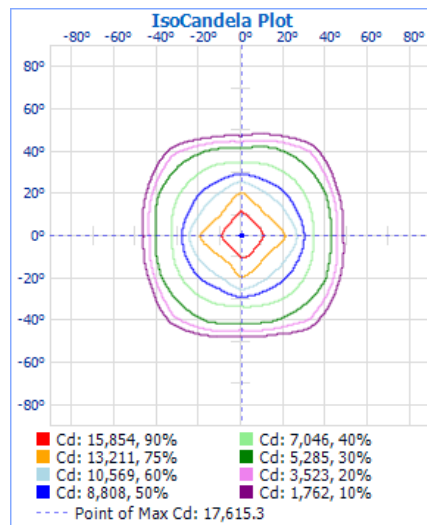

Isocandela Plot

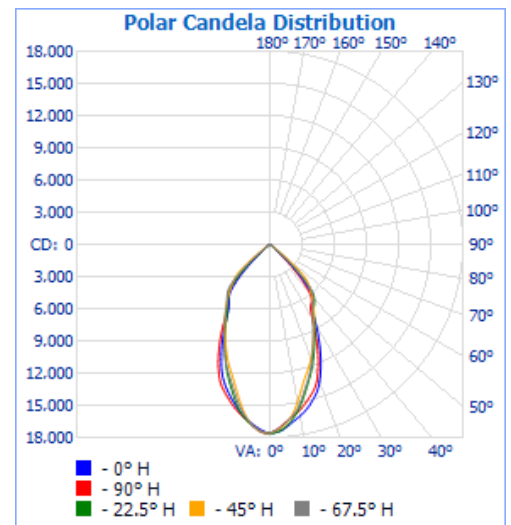

Polar Candela


Maximum Candela = 17,615.3 at Horizontal: 270.0°, Vertical: 1.0°

IESNA LM79-2008 TEST REPORT

April 25, 2014

ISTMT Temperature Measurement

ISTMT temperature measurement at thermal stabilization (8 hours continuous operation).
Thermocouple locations (shown below) are in accordance with manufacturers recommended / stated guidelines for TMP - Temperature Measurement Point.

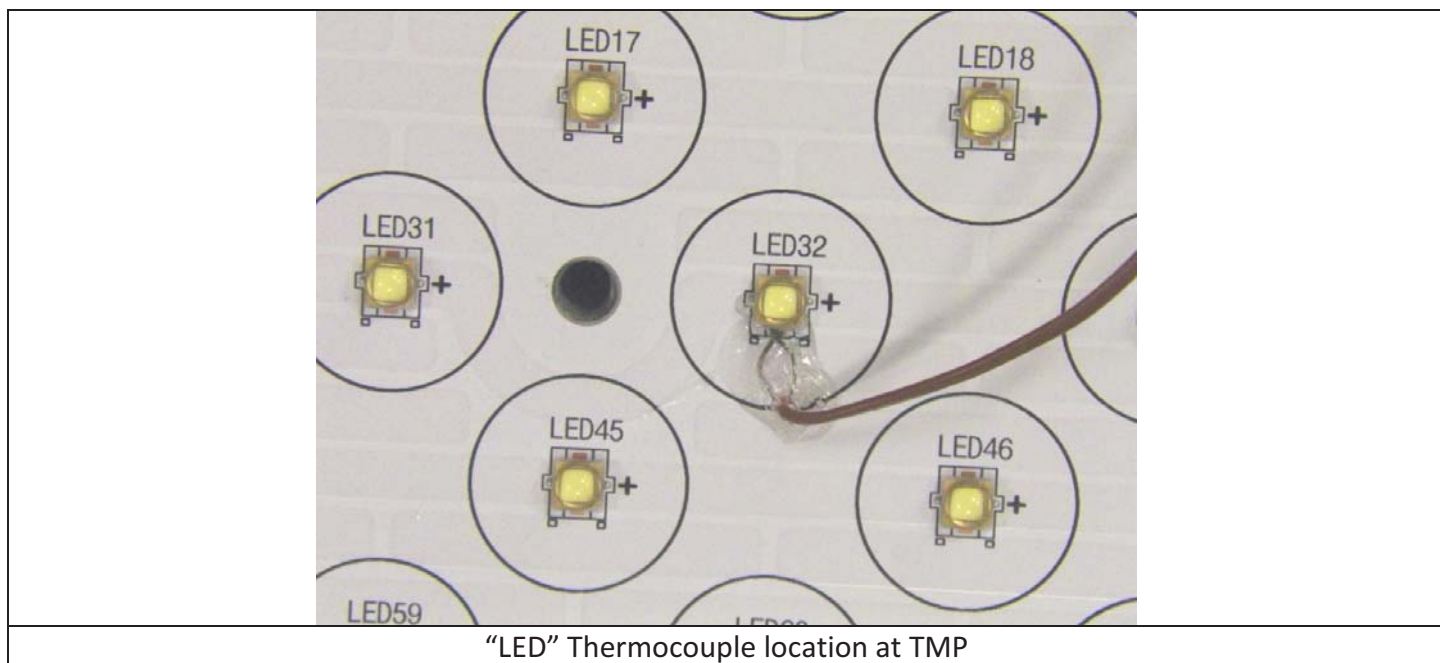

Test Results for Maxlite- ELLF180UM50

LED TMP Temperature	82.6°C
----------------------------	---------------

All temperatures are normalized to 25°C ambient.

Test Equipment

Description	Manufacturer / Model#	TÜV SÜD Ref#	Calibration Due Date
Thermometer	Fluke 52-II	ATLE0118	1/16/2015



IESNA LM79-2008 TEST REPORT


April 25, 2014

Addendum A (DLC Program Results) –

DesignLights Consortium Product Qualification Criteria, Technical Requirements Table, v2.1

08	Architectural Flood and Spot Luminaires	Nominal Requirements	Tolerance	Actual Requirement	Measured Results
	Minimum Light Output	1,000 lm	-10%	900 lm	18,000 lm
	Zonal Lumen Requirements	≥85%: 0-90°	-3%	≥82%	100%
	Minimum Luminaire Efficacy	75 lm/W	-3%	72.75 lm/W	101.4 lm/W
	Allowable CCTs (ANSI C78.377-2008)	≤5700K	Defined by ANSI C78.377	≤5700K	5747 (ANSI max = 6020)
	Minimum CRI	65	-2 points	63	75.8
	L70 Lumen Maintenance	50,000 hrs	None	50,000 hrs	
	Minimum Luminaire Warranty	5 years	None	5 Years	
	Power Factor 120 / 277VAC	≥ 0.9	-3%	0.873	0.996 / 0.936
	Total Harmonic Distortion (THD-A%)	≤20%	+5%	25%	5.57 / 10.75

CIE 1931 x,y Chromaticity Diagram

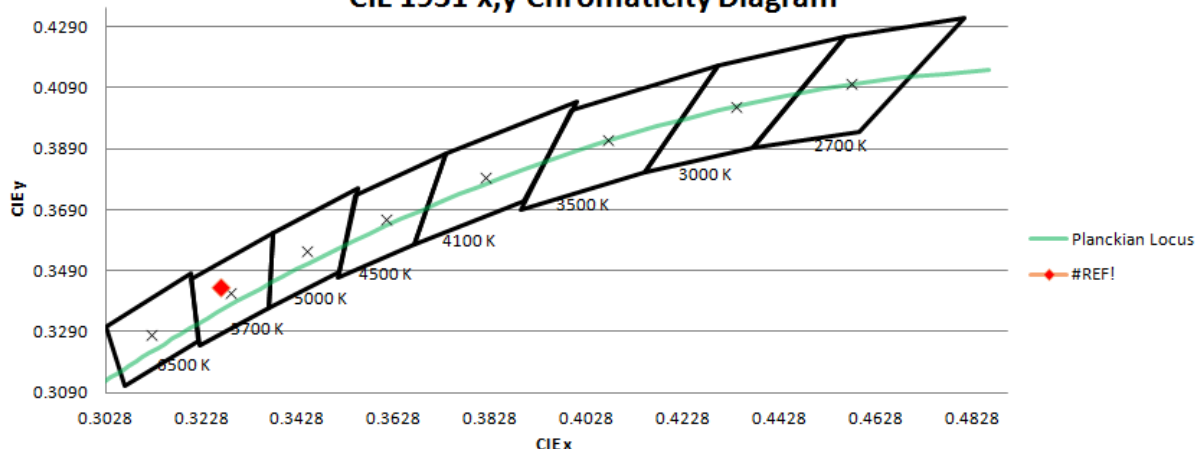



IESNA LM79-2008 TEST REPORT

April 25, 2014

TÜV SÜD Photometric Testing Information

Testing is performed in accordance with the procedures outlined in IESNA LM79-2008. The sample is evaluated for photometric and electrical characteristics using an integrating sphere and a goniophotometer, located in an accredited, temperature and humidity-controlled, draft free photometric laboratory.

Sphere Geometry

The integrating spheres used for measurement utilize a “ 4π geometry” configuration in accordance with section 9 of IES LM-79-2008 and is applicable for all types of SSL products (directional and non-directional light projections). The spectroradiometer is an array-type detector manufactured and calibrated by Labsphere (Model# CDS1100).

Self-Absorption Correction

The integrating sphere uses self-absorption correction to eliminate errors due to mismatches between the standard reference lamp and the test samples being measured. This auxiliary correction lamp is a halogen type lamp powered by a calibrated Lamp Power Supply manufactured and calibrated by Labsphere (model LPS150). Ambient temperature is measured using a thermocouple located inside the integrating sphere at the same height as the sample under test (UUT) and not more than 1 meter in horizontal distance away from the sample (section 2.2 of LM79-2008). The thermocouple is located behind a baffle in order to eliminate any direct optical radiation from the sample under test.

Sample Stabilization

The sample (UUT) is placed inside the integrating sphere and powered by a regulated and conditioned alternating or direct current supply. The stabilization times shown on the results pages of this report denote the time of the 3rd measurement (of the 3 consecutive readings) since this is the minimum time that the sample is assumed to have taken to reach stabilization in accordance with section 5.0 of LM79-2008.

Sphere Calibration

The integrating sphere is calibrated using a quartzline halogen lamp with the following specifications:

Manufacturer: EYE Lighting International

Model# J94/JD28V75W

Voltage = 28.0 Volts DC

Wattage = 75.0 Watts

Calibration Current = 2.679 Amperes

Luminous Flux = 1685 Lumens

Calibration Date = 2-17-2011 (calibrated by Labsphere – NIST traceable).

Continued.....

TÜV SÜD America, Inc.

5945 Cabot Parkway, Suite 100,
Alpharetta GA 30005

Telephone: 678-341-5900 www.tuvamerica.com

Page 9

NRG_F_10.04

Confidential Report



Lab Code: 500065-0

TÜV SÜD America is
accredited under the
NVLAP EEL program.



IESNA LM79-2008 TEST REPORT

Report# JI1404143-01-LM79

April 25, 2014

TÜV SÜD Photometric Testing Information (continued)

Goniophotometer

The Goniophotometer is a Mirror based Type C optical measurement system in accordance with section 9.3.1 of IESNA LM79-2008.

Goniophotometer Calibration

The Goniophotometer is calibrated using a frosted tungsten filament FDS/DZE lamp with the following specifications:

- Manufacturer: General Electric
- Part Number: CSB-110
- Lamp Number: 112-A
- Voltage: 16.52 Volts DC
- Wattage: 150.0 Watts
- Calibration Current: 4.816 Amperes
- Luminous Intensity: 151.5 Candelas
- Calibration Date: 02-13-2011 (NIST traceable)

TÜV SÜD Test Equipment List:

TÜV SÜD Sphere System – contains the following:			
Description	Manufacturer / Model#	TÜV SÜD Ref#	Calibration Due Date
Integrating Sphere	Labsphere LM760	SPH003	weekly
Spectroradiometer	Labsphere CDS1100	ATLE0048	9/7/2014
Power Analyzer	Yokogawa WT210	ATLE0032	11/21/2014
Power Source	Chroma 61602	AC003	N/A
Thermometer	Fluke 52-II	ATLE0118	1/16/2015
TÜV SÜD Mirror Goniophotometer System – contains the following:			
Goniophotometer	M.E. GONC02	GON002	Weekly
Spectroradiometer	Gigahertz Optik P9801	GIG002	Weekly
Power Analyzer	Yokogawa WT210	ATLE0031	11/21/2014
Power Source	Chroma 61603	AC007	N/A

This technical report may only be quoted in full. Any use for advertising purposes must be granted in writing. This report is the result of a single examination of the object in question and is not generally applicable evaluation of the quality of other products in regular production.

This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the Federal Government

TÜV SÜD America, Inc.
5945 Cabot Parkway, Suite 100,
Alpharetta GA 30005

Telephone: 678-341-5900 www.tuvamerica.com

Page 10

NRG_F_10.04

Confidential Report



TÜV SÜD America is accredited under the NVLAP EEL program.

